


NOTE:
THE PUMPER NOZZLE SHALL BE EQUIPPED
WITH A 4" STORZ QUICK CONNECT COUPLING

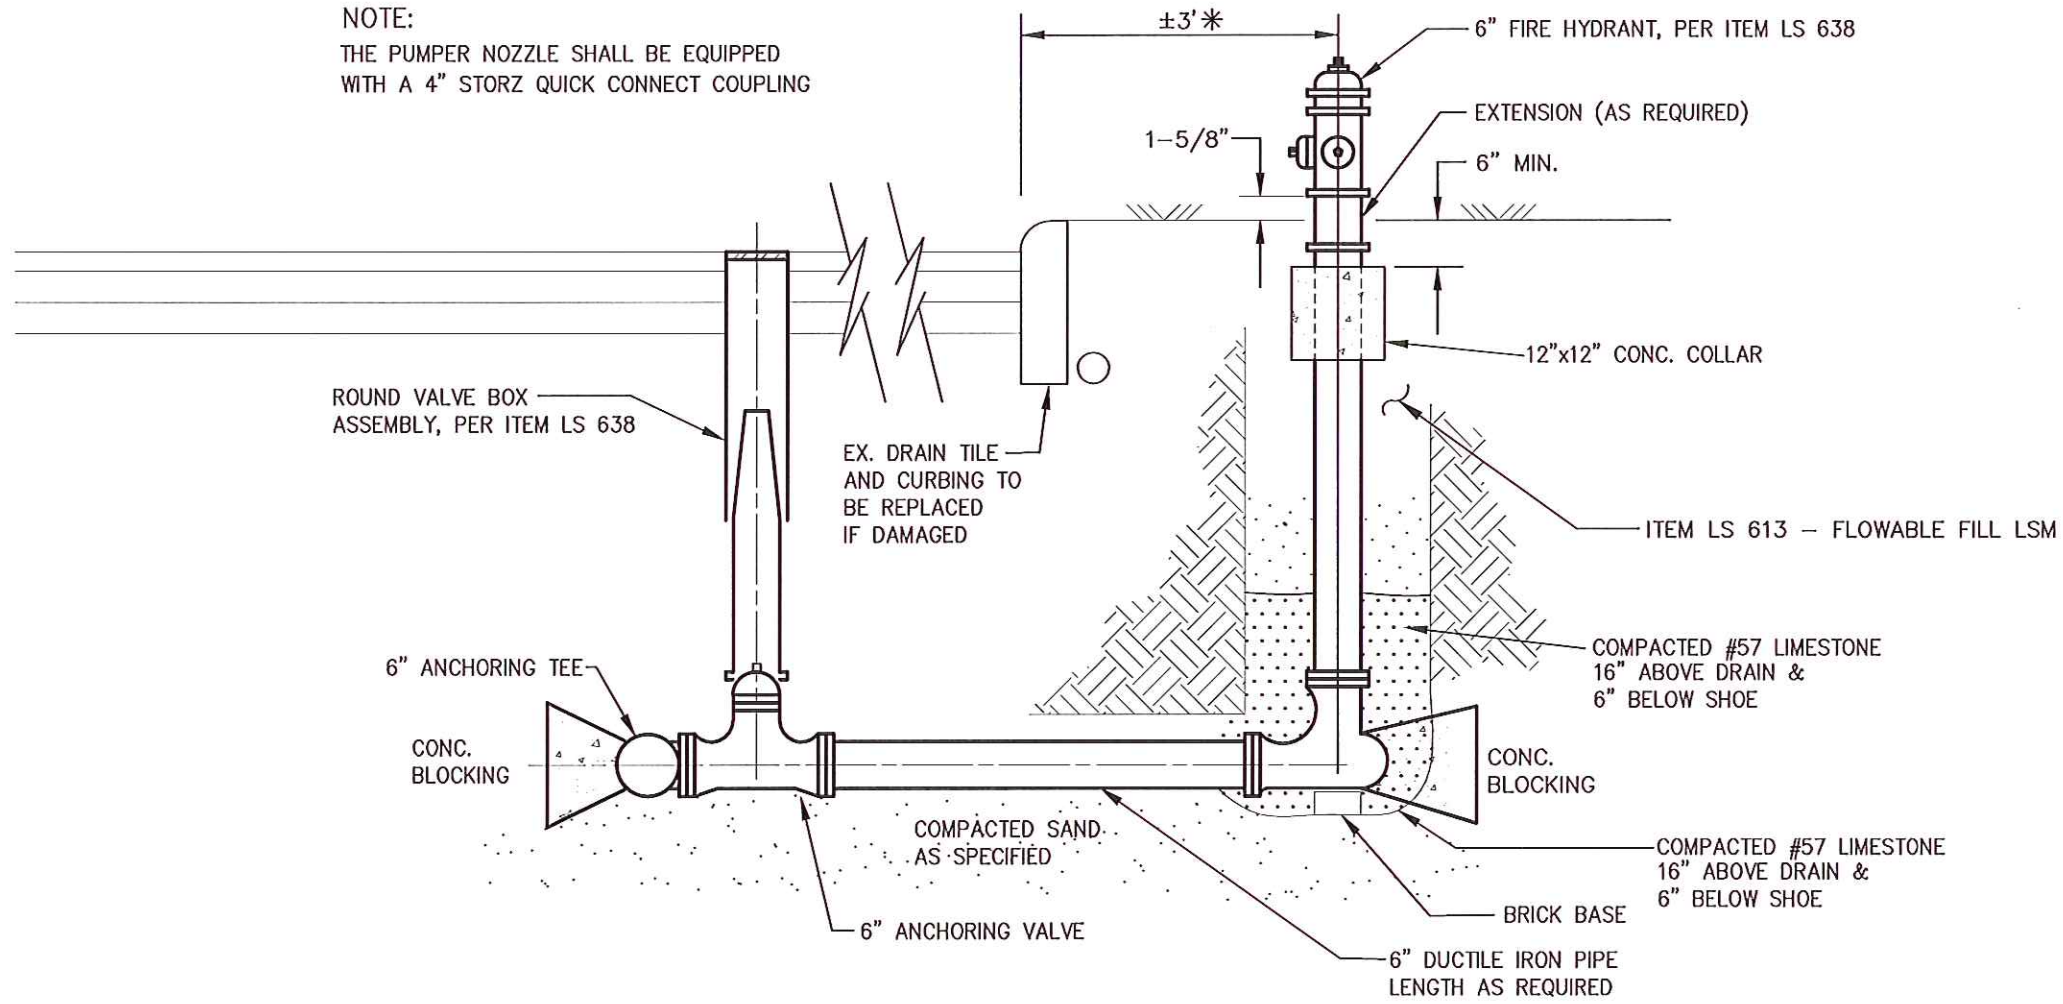

6" FIRE HYDRANT

SCALE: NONE

*LOCATION OF HYDRANTS
IN TREELAWN TO BE
DETERMINED IN FIELD.

CITY OF LAKEWOOD, OHIO

04-13-2015
DATE

MARK PARKE, PE, CPESC
CITY ENGINEER



REVISIONS:
01-31-2014

SCALE:
N.T.S.

STANDARD DRAWING:
FIRE HYDRANT

NUMBER:
W-2

1 / 1