


AIR CONDITIONER – CONDENSING UNIT – SIDE YARD PLACEMENT WORKSHEET

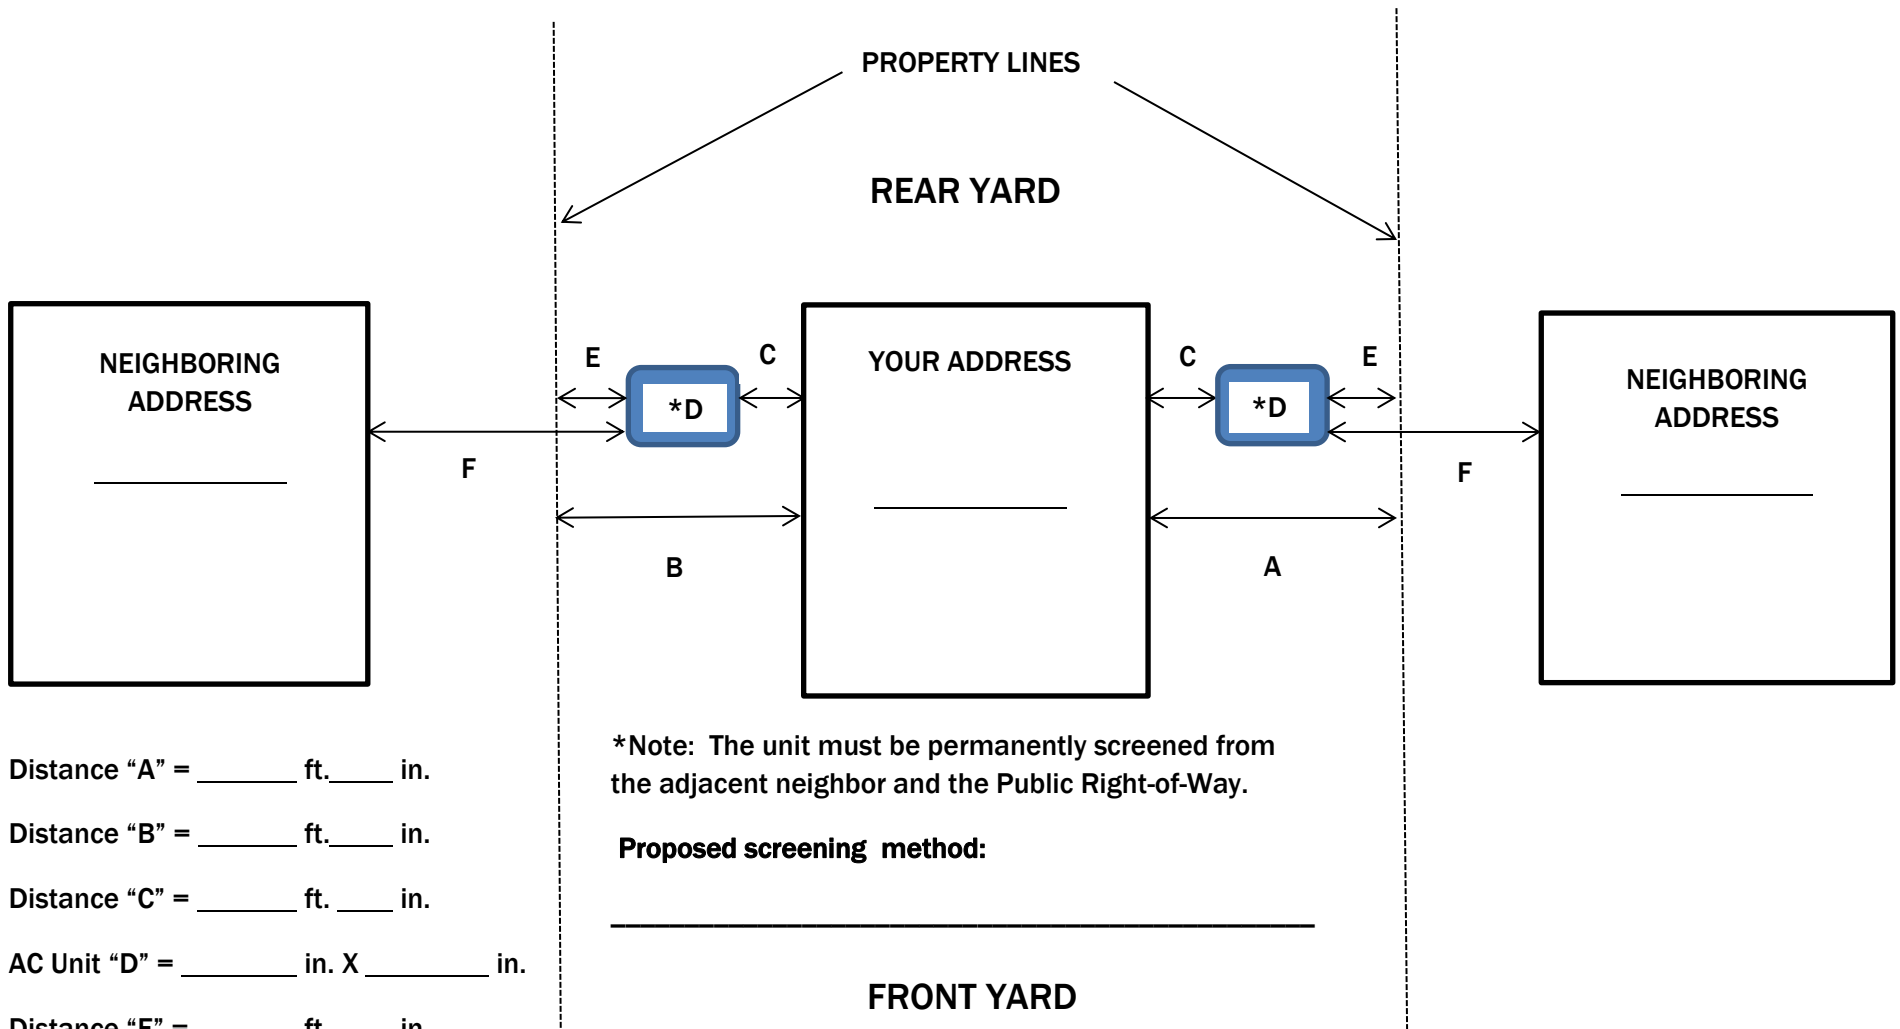

Distance "A" = _____ ft. ____ in.

Distance "B" = _____ ft. ____ in.

Distance "C" = _____ ft. ____ in.

AC Unit "D" = _____ in. X _____ in.

Distance "E" = _____ ft. ____ in.

Distance "F" = _____ ft. ____ in.

ANSI/AHRI Sound Rating of Unit _____

THE LAKEWOOD BUILDING DEPARTMENT CANNOT DETERMINE PROPERTY LINES. PROPERTY LINES ARE THE SOLE RESPONSIBILITY OF THE HOMEOWNER.

